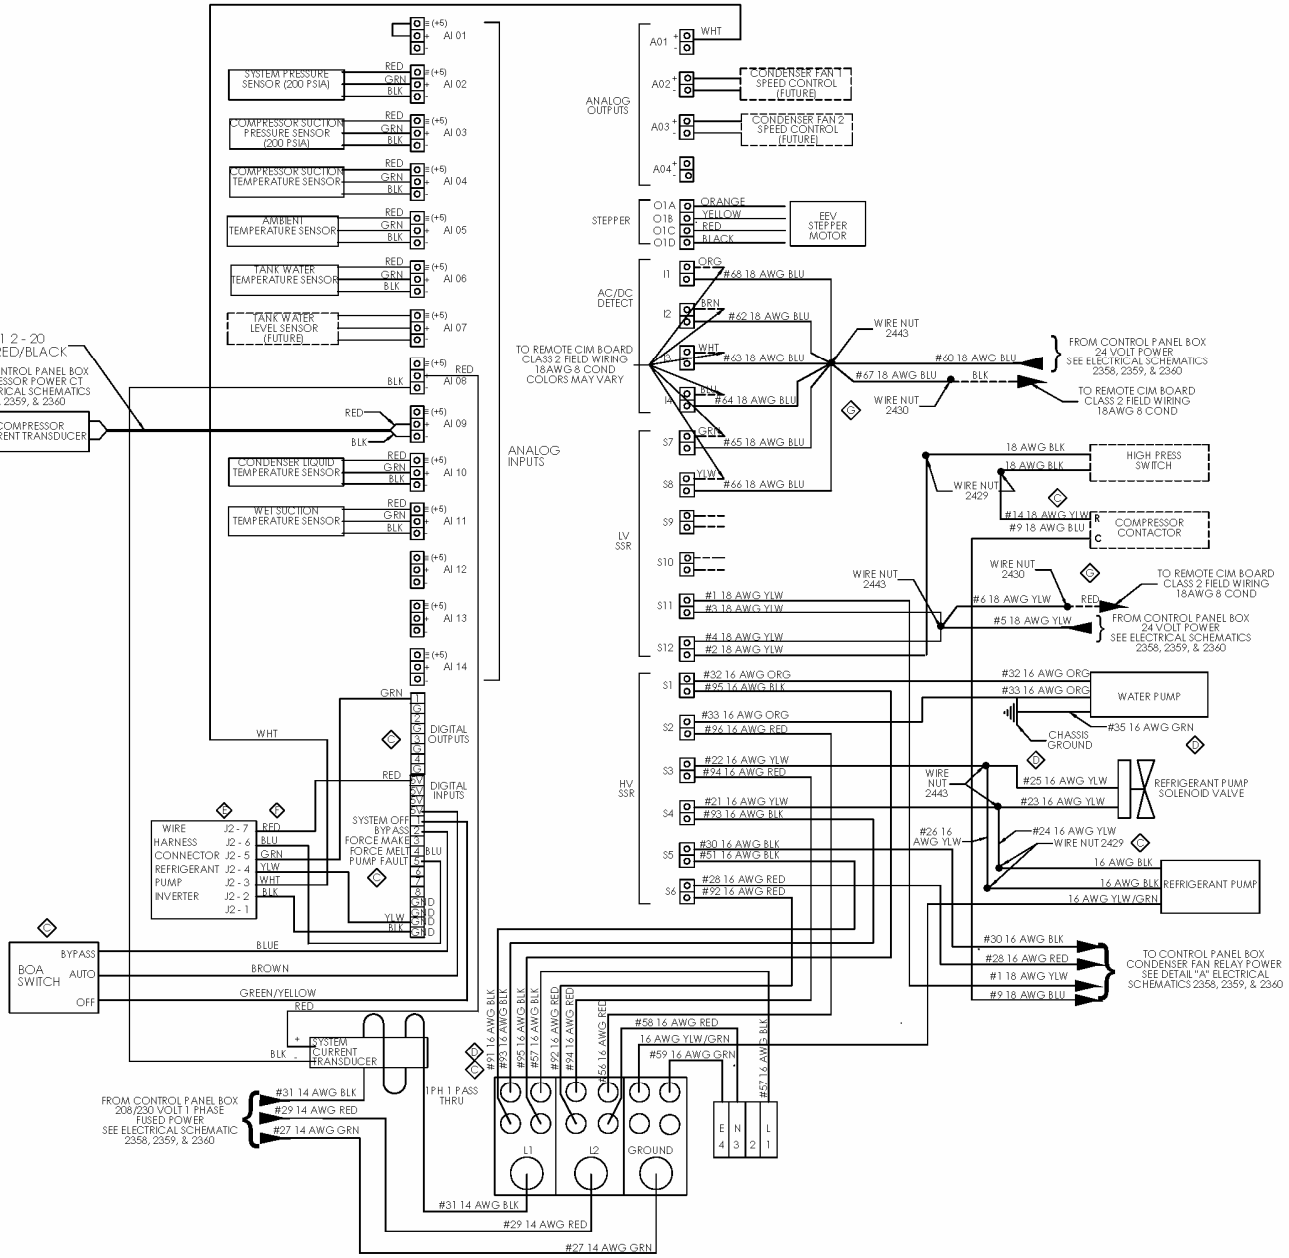

NOTES:
1. SYMBOLS ARE ELECTRICAL REPRESENTATION ONLY.
2. TO BE WIRED IN ACCORDANCE WITH NATIONAL ELECTRIC N.E.C. AND LOCAL CODES.
3. USE COPPER CONDUCTORS ONLY. USE COPPER WIRE ONLY, RATED 70° C OR HIGHER
   UTILISEZ DES FILS EN CUIVRE SEULEMENT, CLASSE 75°C OU PLUS
4. CHECK ALL ELECTRICAL CONNECTIONS INSIDE CONTROL BOX FOR TIGHTNESS.

REFERENCE WIRING HARNESS 2422, 2423, 2486, 2892, & 2894

ICE ENERGY®
INTELLIGENT STORAGE AT WORK.™

Ice Bear® 30 Unit
CoolData® Controller Electrical Schematic
Ref. # 2361 Rev G